


**BLDG 7 HVAC POWER PLAN**  
SCALE: 1/8" = 1'-0"

- NOTES:
1. FIELD VERIFY ALL CIRCUITS IN AREA OF WORK AND REUSE EXISTING CIRCUITS WHERE PRACTICAL. REMOVE ALL CIRCUITS NOT BEING USED AND UPDATE PANEL SCHEDULES.
  2. CONFIRM EXISTING PANEL LOAD AND AVAILABLE CAPACITY.

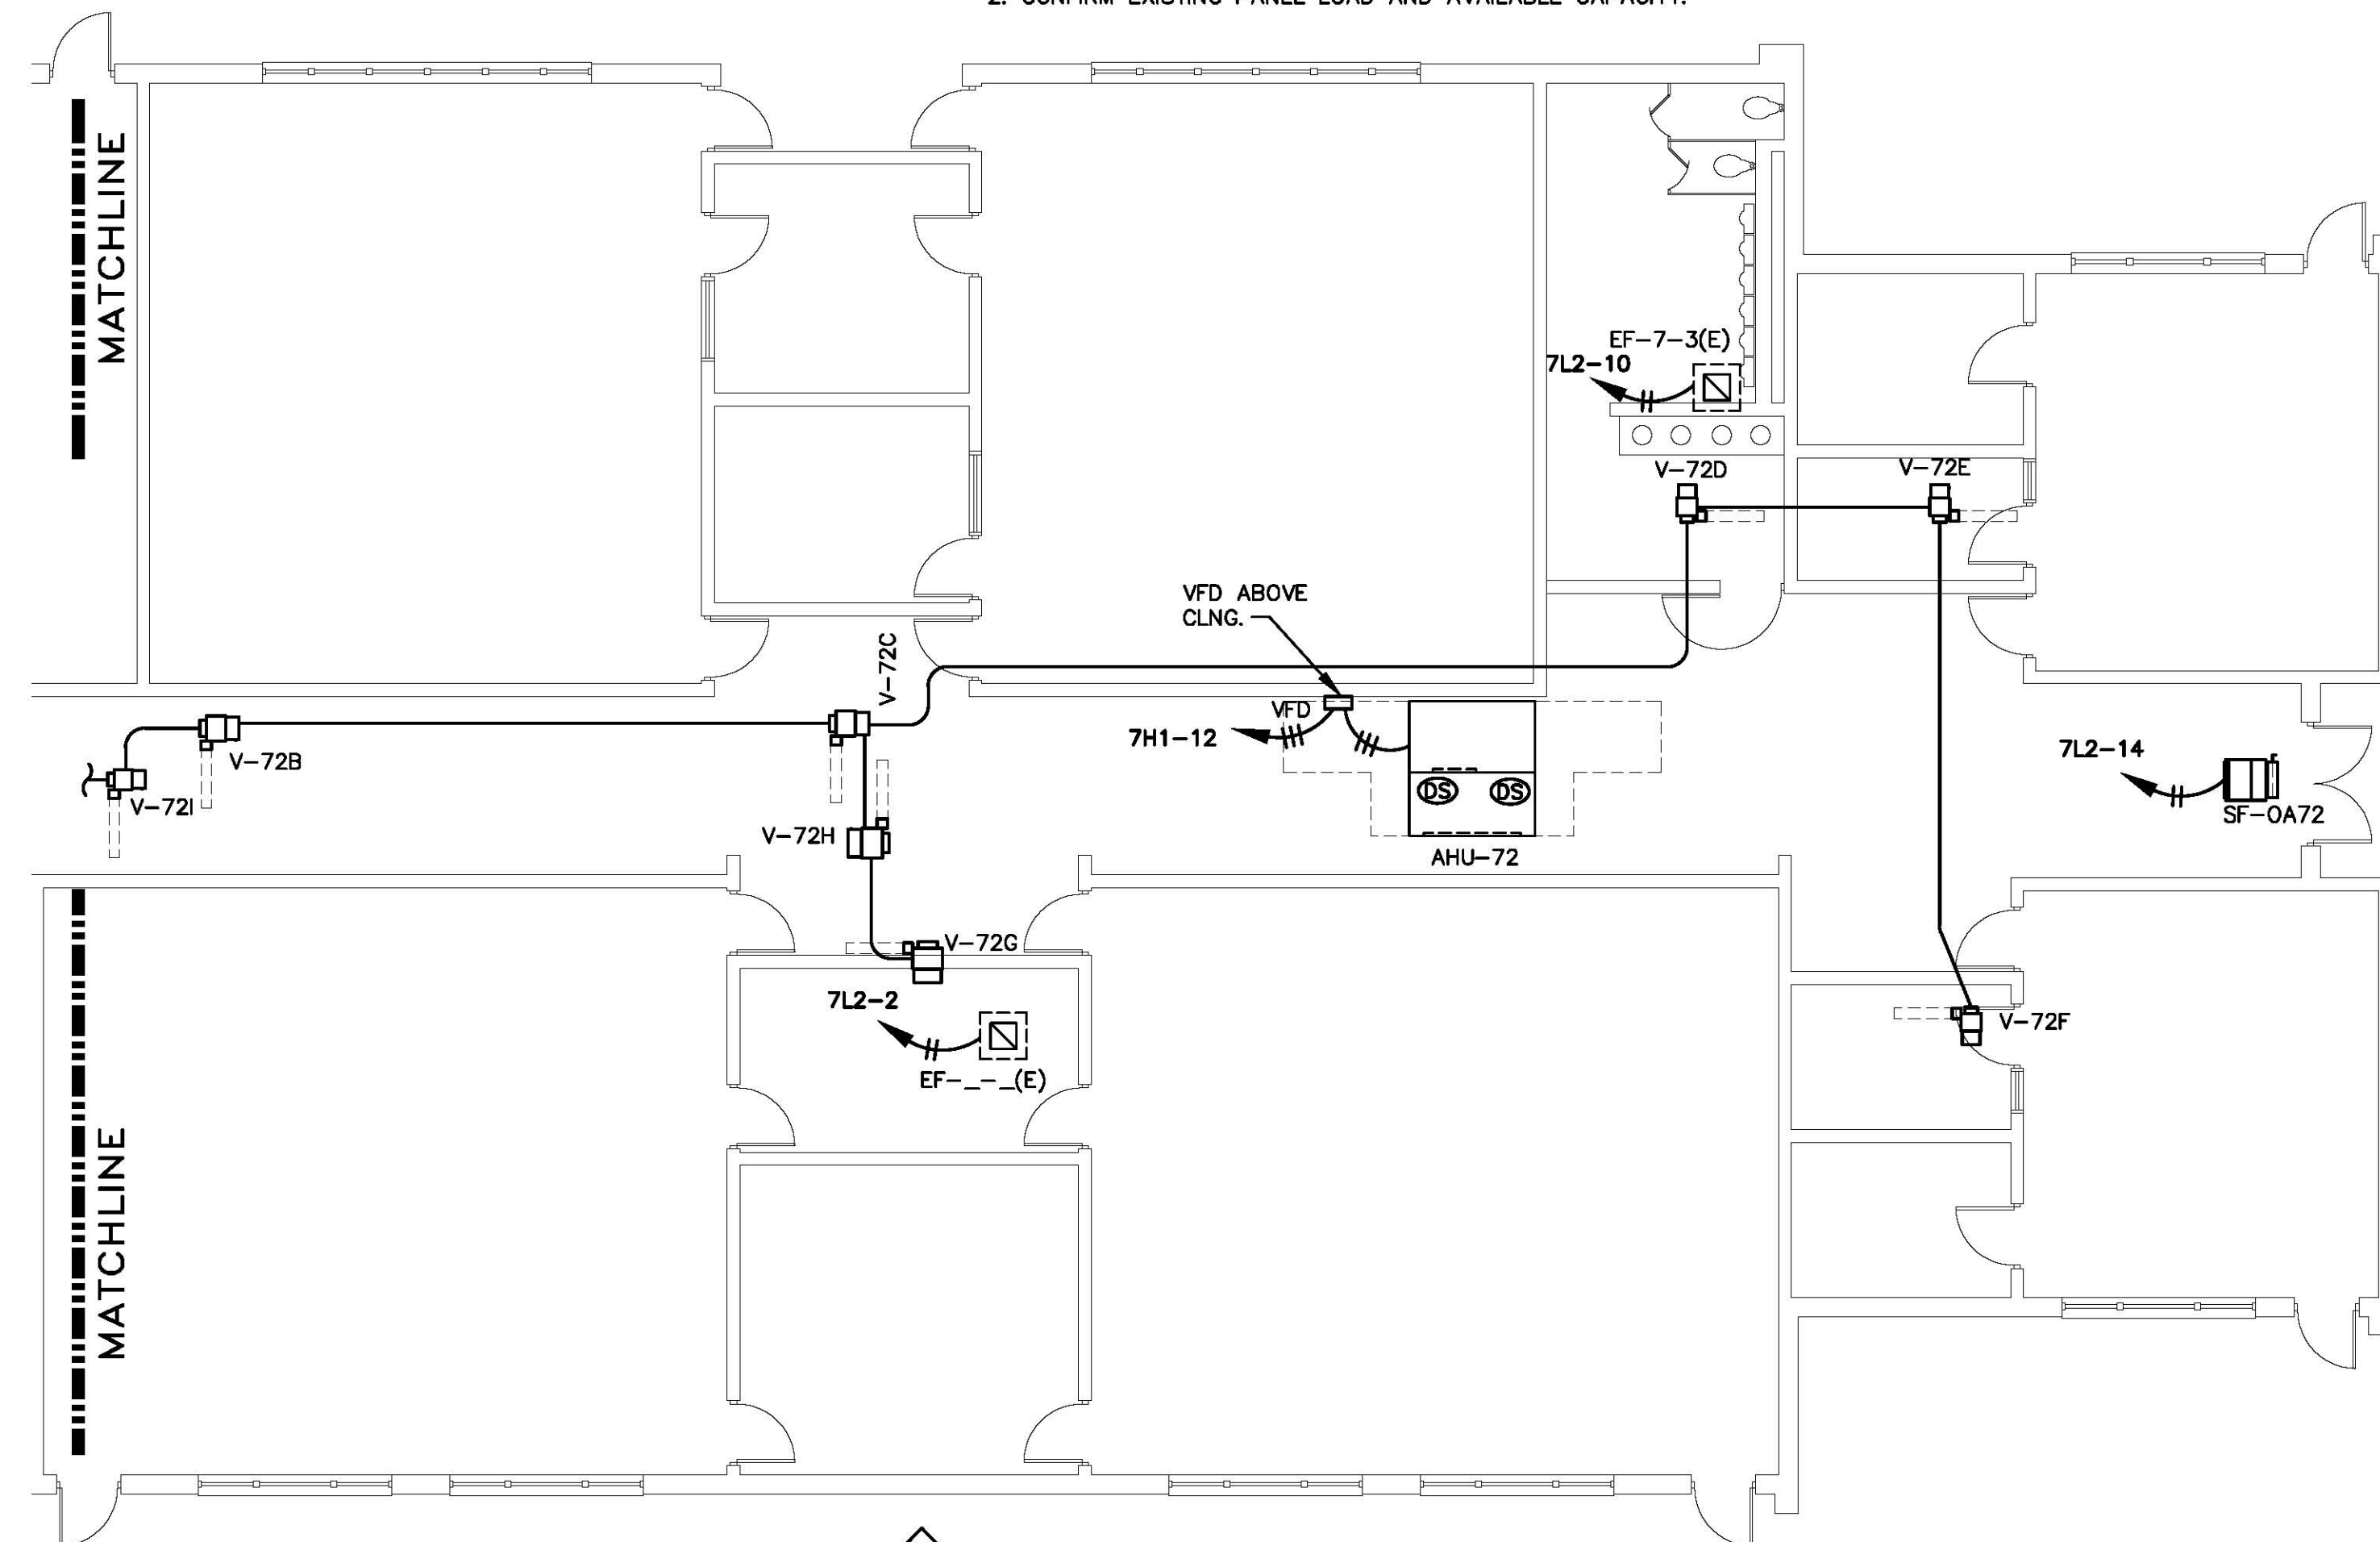

**BLDG 7 HVAC POWER PLAN. CONT.**  
SCALE: 1/8" = 1'-0"

REVISIONS

POWELL & HINKLE ENGINEERING  
1409 KINGSLEY AVENUE, BLDG 12A  
ORANGE PARK, FLORIDA 32073  
(904) 264-5570 FAX: (904) 278-2646  
FLA. REG. # EB-0004577

SUWANNEE COUNTY MIDDLE SCHOOL  
HVAC MODIFICATIONS - BUILDING 7  
LIVE OAK, FLORIDA

DATE: 2-17-12  
SCALE: 1/8"=1'-0"  
DRAWN: DBH  
JOB: 1947  
SHEET:

E-1  
OF 2 SHEETS

2/16/12  
1947E1