



6" DEEP GALV. STEEL DRAIN PAN WITH MOISTURE SENSOR FOR FAN SHUT-OFF PER CODE REQUIREMENTS

VIBRATION ISOLATOR KINETICS MODEL NPD


DETAIL - CENTRAL AIR HANDLER
NOT TO SCALE

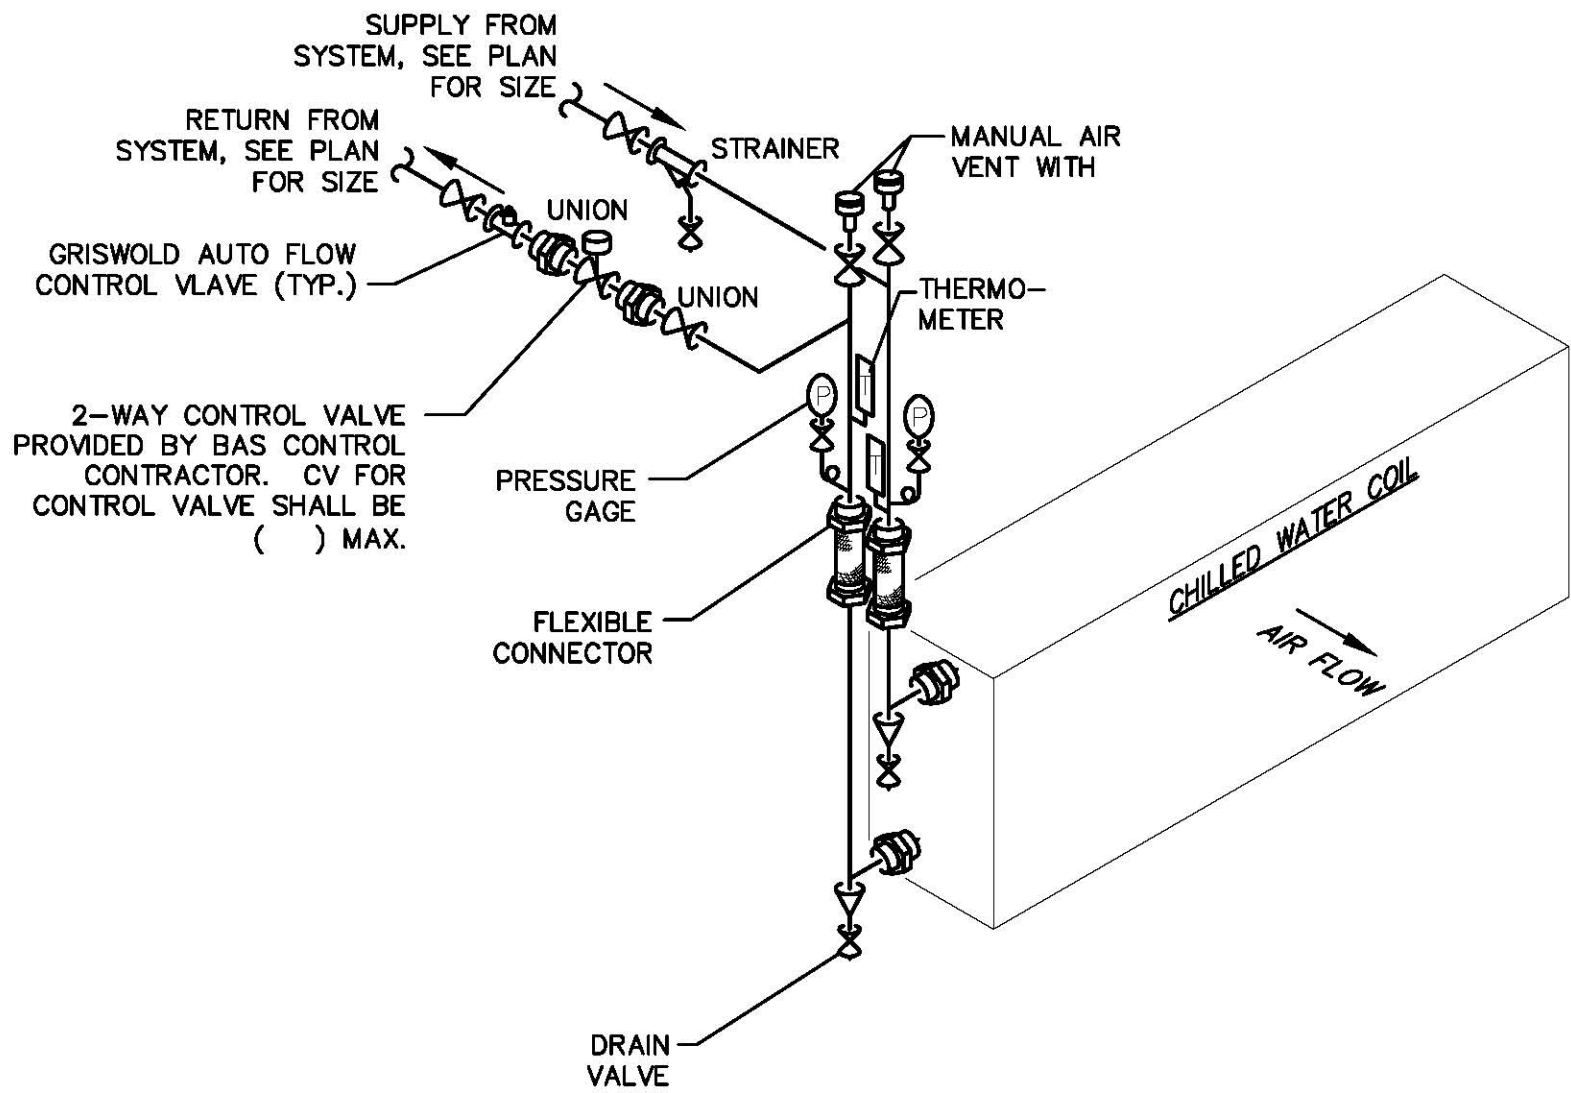


DETAIL - CENTRAL AIR HANDLER CHILLED WATER PIPING DIAGRAM
NOT TO SCALE

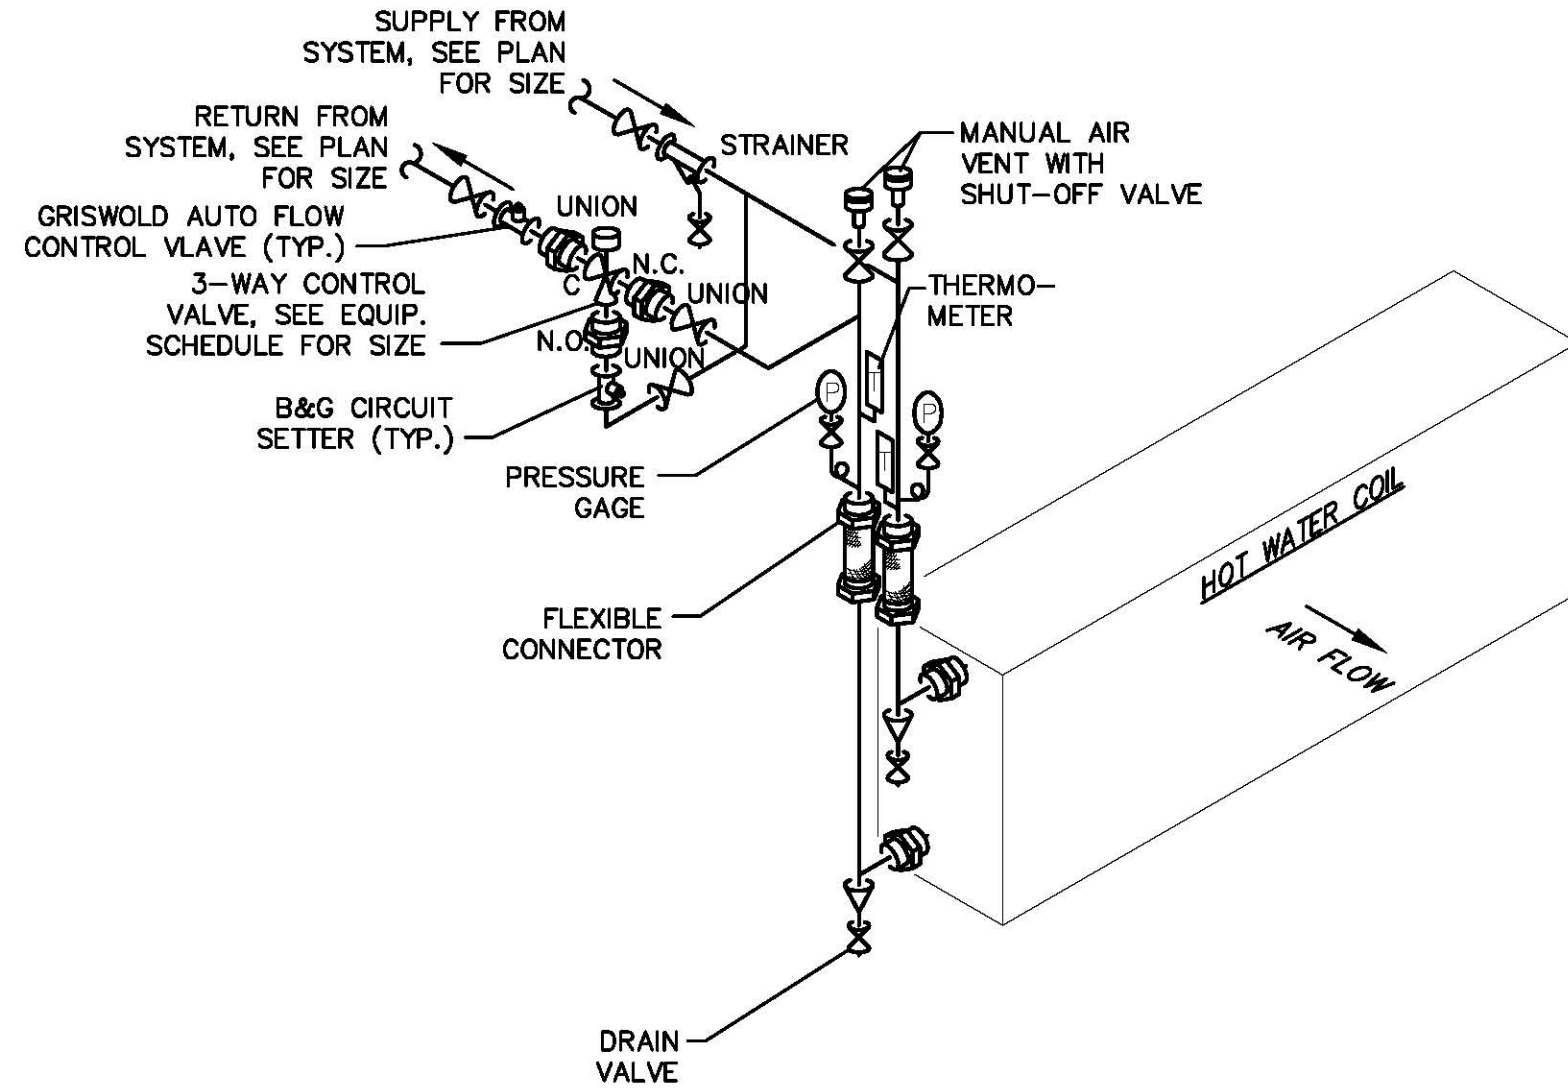


DETAIL - CENTRAL AIR HANDLER HOT WATER PIPING DIAGRAM
NOT TO SCALE

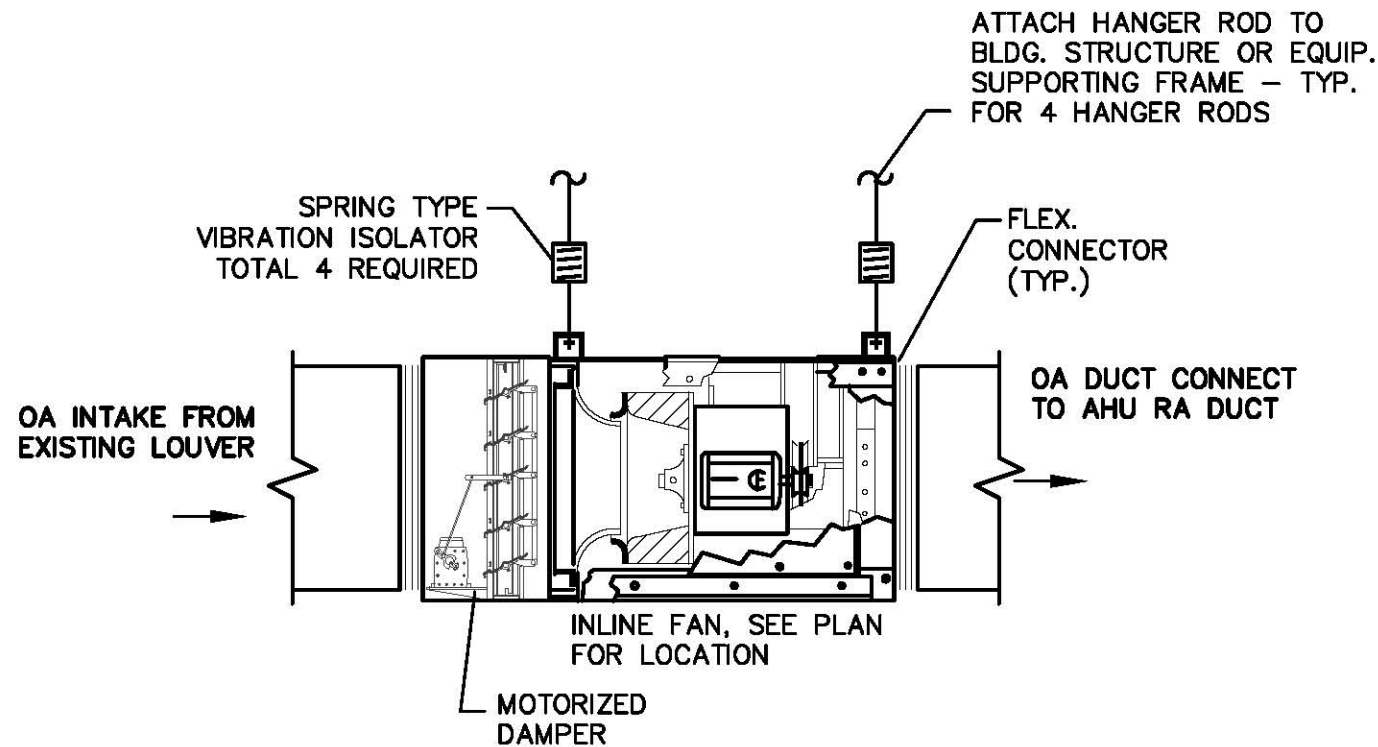


DETAIL - INLINE FAN
NOT TO SCALE

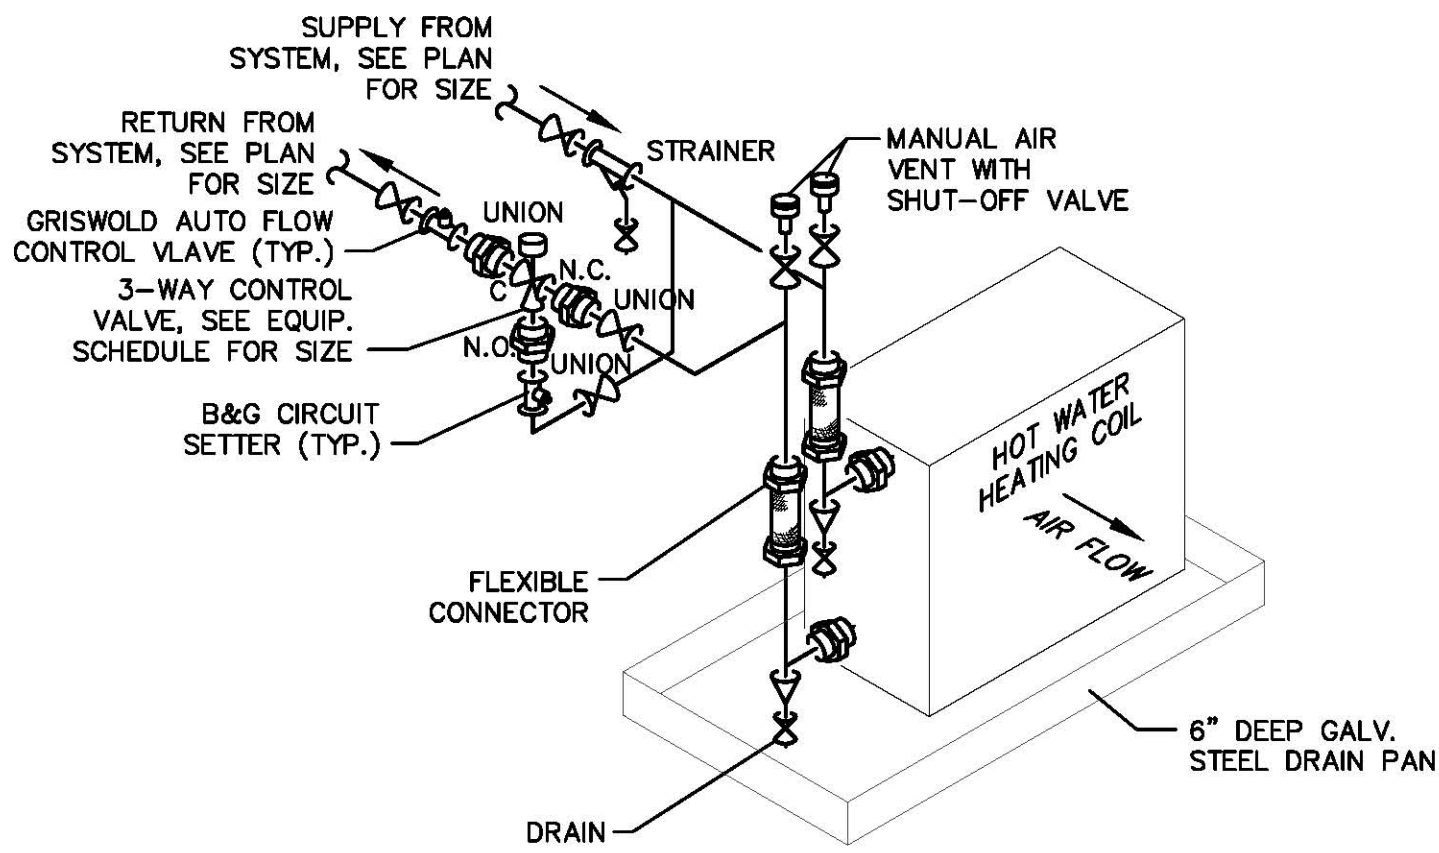


DETAIL - HEATING COIL FOR OA FAN AND VAV UNITS
NOT TO SCALE

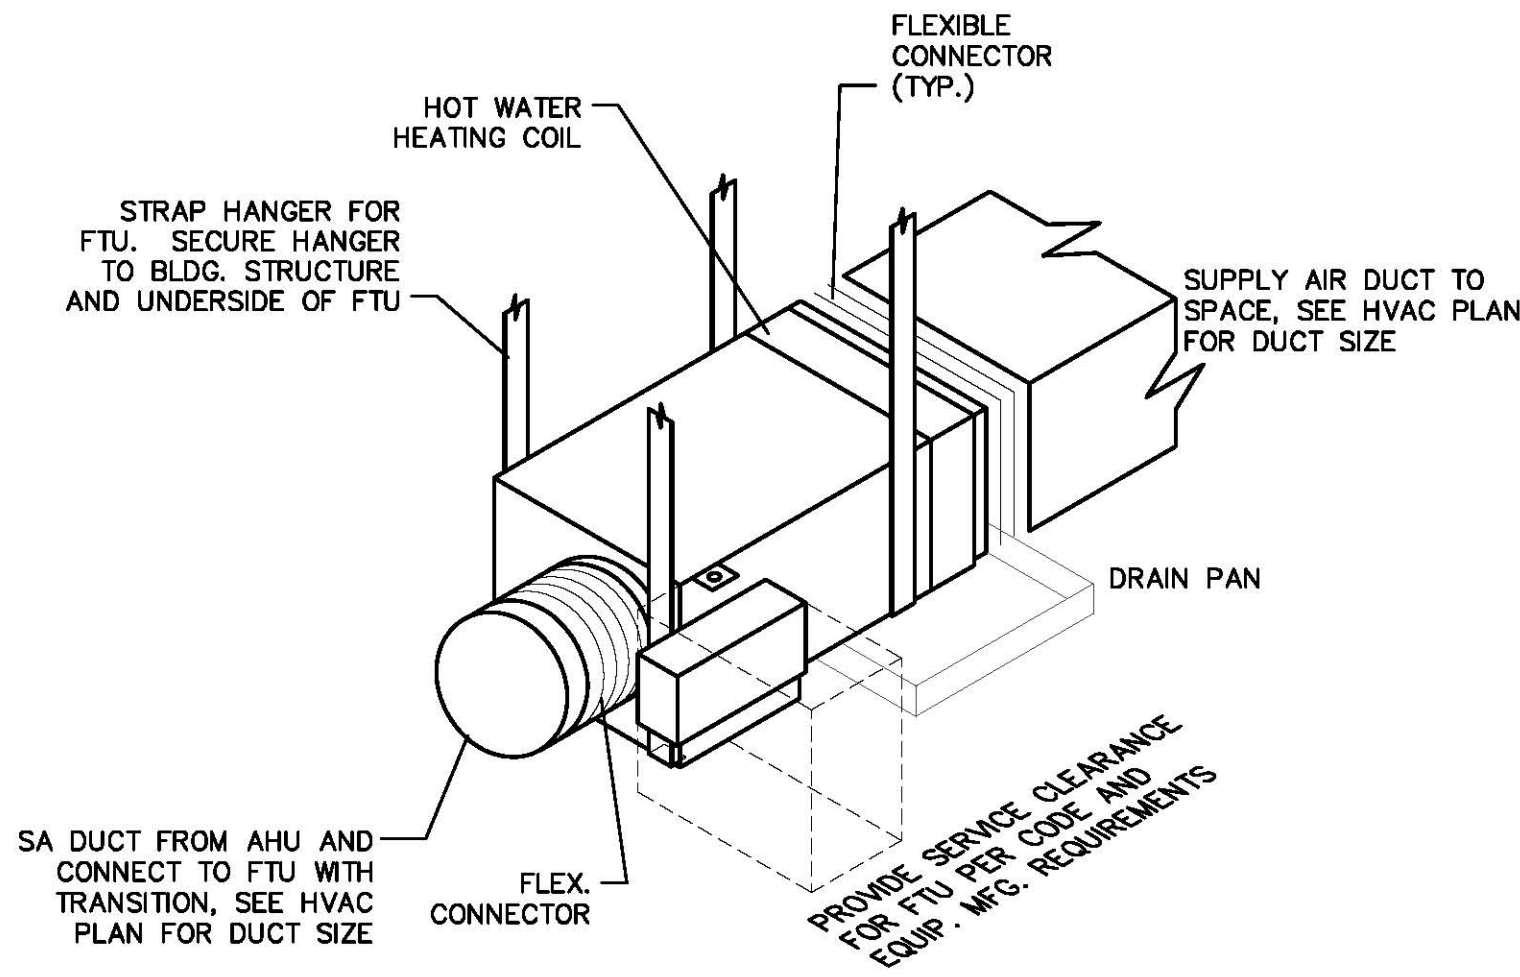

DETAIL - VAV SUPPORT
NOT TO SCALE

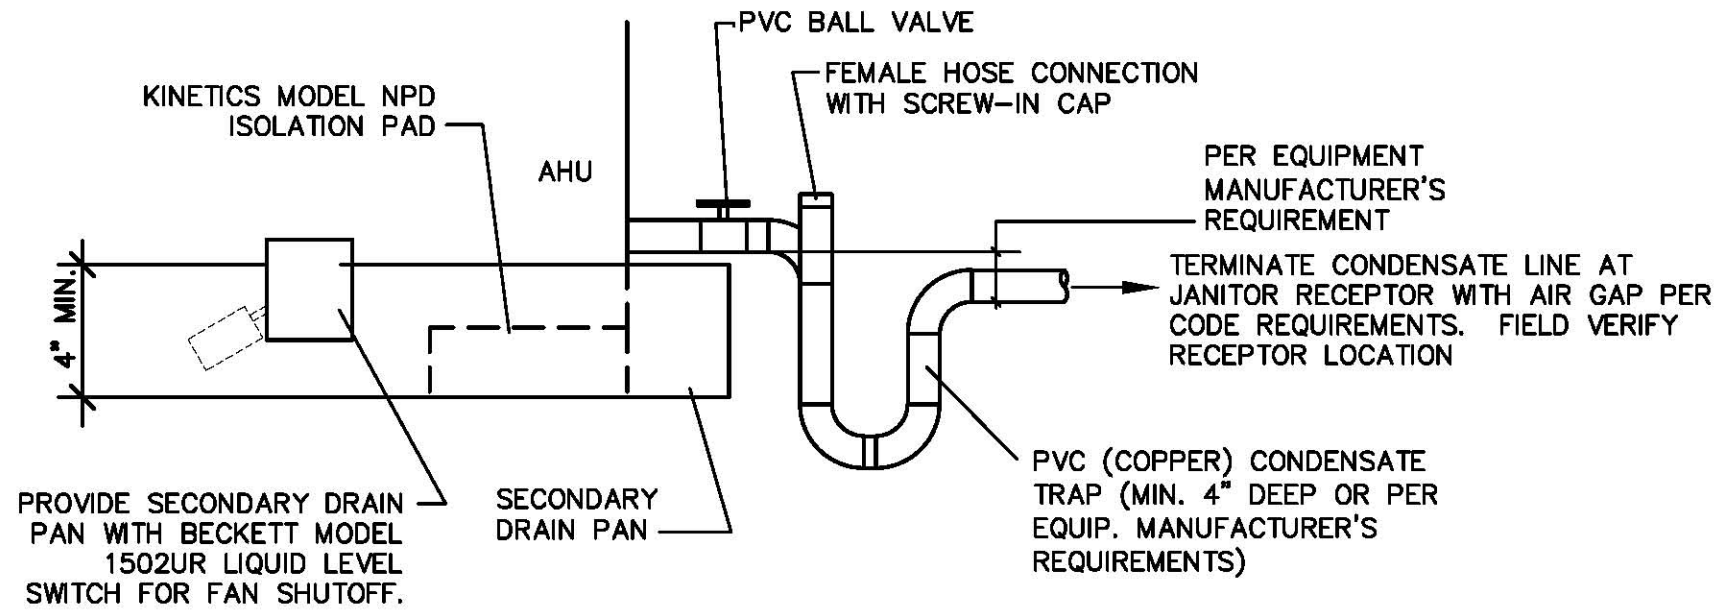


DETAIL - DRAIN PAN AND CONDENSETE TRAP
NOT TO SCALE

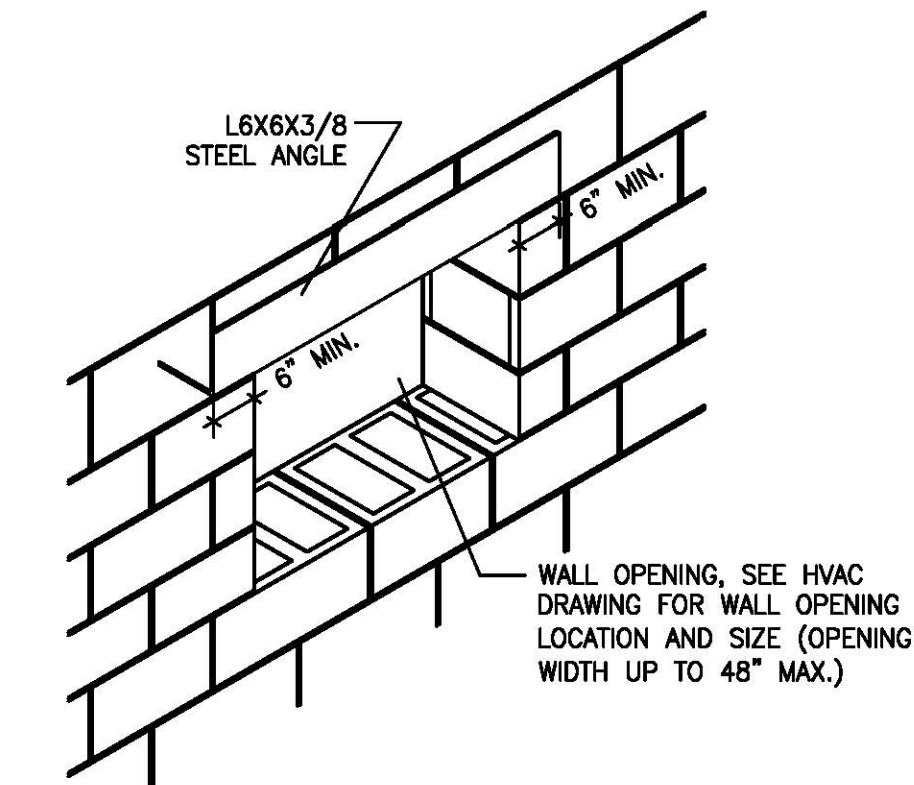

WALL FRAMING
CMU WALL OPENING SECTION
NTS

REVISIONS

POWELL & HINKLE ENGINEERING
1409 KINGSLEY AVENUE, BLDG 12A
ORANGE PARK, FLORIDA 32073
(904) 264-5570 FAX: (904) 278-2646
FLA. REG. # EB-0004577



SUWANNEE COUNTY MIDDLE SCHOOL
HVAC MODIFICATIONS - BUILDING 7
LIVE OAK, FLORIDA

DATE: 2/17/12
SCALE: AS SHOWN
DRAWN: GCM
JOB: 1947
SHEET:

M-5
OF 6 SHEETS